


ANSI C119.1-2011

American National
Standard for Electric
Connectors - Sealed
Insulated Underground
Connector Systems
Rated 600 Volts



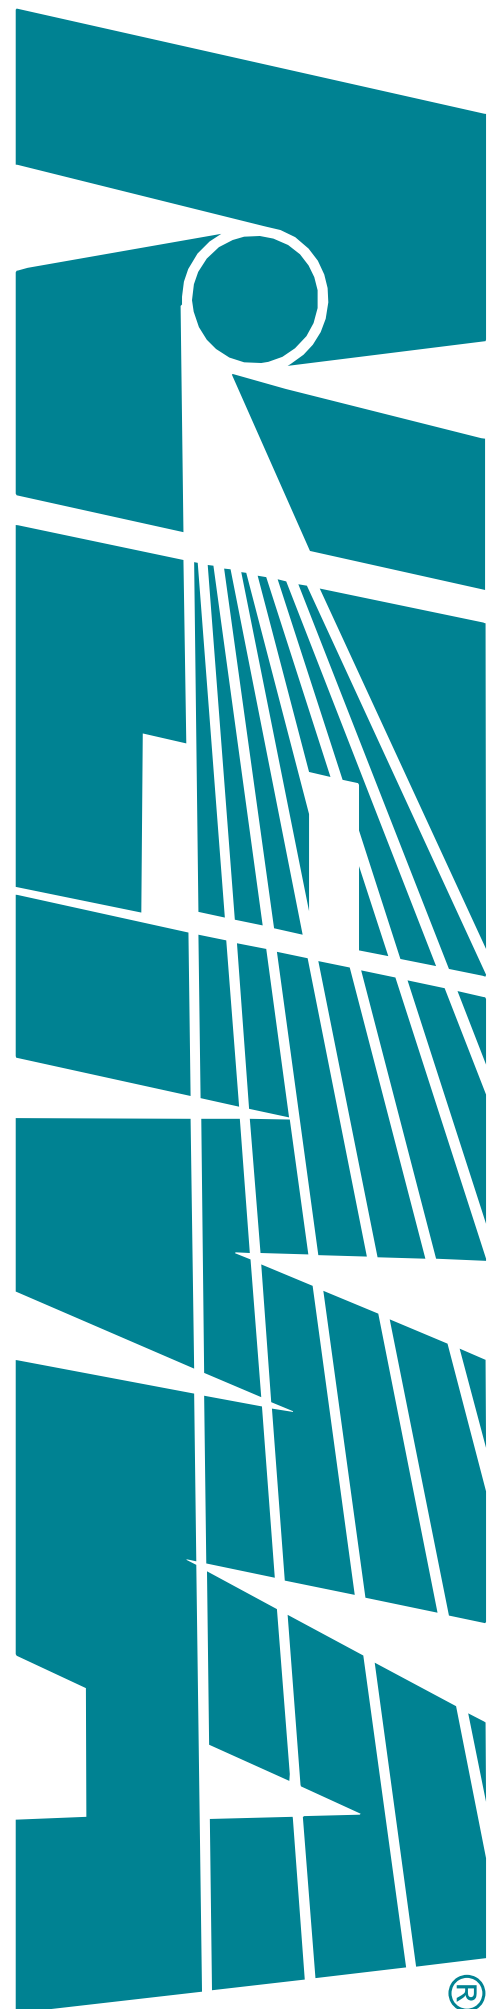

ANSI C119.1-2011

American National Standard

for Electric Connectors—
Sealed Insulated Underground
Connector Systems
Rated 600 Volts



ANSI C119.1-2011

American National Standard
for Electric Connectors—
Sealed Insulated Underground Connector Systems
Rated 600 Volts

Secretariat:

National Electrical Manufacturers Association

Approved January 13, 2011

American National Standards Institute, Inc.

NOTICE AND DISCLAIMER

The information in this publication was considered technically sound by the consensus of persons engaged in the development and approval of the document at the time it was developed. Consensus does not necessarily mean that there is unanimous agreement among every person participating in the development of this document.

ANSI standards and guideline publications, of which the document contained herein is one, are developed through a voluntary consensus standards development process. This process brings together volunteers and/or seeks out the views of persons who have an interest in the topic covered by this publication. While NEMA administers the process to promote fairness in the development of consensus, it does not write the document and it does not independently test, evaluate, or verify the accuracy or completeness of any information or the soundness of any judgments contained in its standards and guideline publications. NEMA disclaims liability for any personal injury, property, or other damages of any nature whatsoever, whether special, indirect, consequential, or compensatory, directly or indirectly resulting from the publication, use of, application, or reliance on this document.

NEMA disclaims and makes no guaranty or warranty, express or implied, as to the accuracy or completeness of any information published herein, and disclaims and makes no warranty that the information in this document will fulfill any of your particular purposes or needs. NEMA does not undertake to guarantee the performance of any individual manufacturer or seller's products or services by virtue of this standard or guide.

In publishing and making this document available, NEMA is not undertaking to render professional or other services for or on behalf of any person or entity, nor is NEMA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances. Information and other standards on the topic covered by this publication may be available from other sources, which the user may wish to consult for additional views or information not covered by this publication.

NEMA has no power, nor does it undertake to police or enforce compliance with the contents of this document. NEMA does not certify, test, or inspect products, designs, or installations for safety or health purposes. Any certification or other statement of compliance with any health or safety-related information in this document shall not be attributable to NEMA and is solely the responsibility of the certifier or maker of the statement.

AMERICAN NATIONAL STANDARD

Approval of an American National Standard requires verification by ANSI that the requirements for due process, consensus, and other criteria for approval have been met by the standards developer.

Consensus is established when, in the judgment of the ANSI Board of Standards Review, substantial agreement has been reached by directly and materially affected interests. Substantial agreement means much more than a simple majority, but not necessarily unanimity. Consensus requires that all views and objections be considered, and that a concerted effort be made toward their resolution.

The use of American National Standards is completely voluntary; their existence does not in any respect preclude anyone, whether he has approved the standards or not, from manufacturing, marketing, purchasing, or using products, processes, or procedures not conforming to the standards.

The American National Standards Institute does not develop standards and will in no circumstances give an interpretation of any American National Standard. Moreover, no person shall have the right or authority to issue an interpretation of an American National Standard in the name of the American National Standards Institute. Requests for interpretations should be addressed to the secretariat or sponsor whose name appears on the title page of this standard.

Caution Notice: This American National Standard may be revised or withdrawn at any time. The procedures of the American National Standards Institute require that action be taken periodically to reaffirm, revise, or withdraw this standard. Purchasers of American National Standards may receive current information on all standards by calling or writing the American National Standards Institute.

Published by:

**National Electrical Manufacturers Association
1300 North 17th Street, Rosslyn, VA 22209**

© Copyright 2011 by National Electrical Manufacturers Association

All rights reserved including translation into other languages, reserved under the Universal Copyright Convention, the Berne Convention for the Protection of Literary and Artistic Works, and the International and Pan American Copyright Conventions.

No part of this publication may be reproduced in any form, in an electronic retrieval system or otherwise, without the prior written permission of the publisher.

Printed in the United States of America.

< This page intentionally left blank. >

Contents

Foreword..... v

1 Scope and Purpose..... 1

 1.1 Scope..... 1

 1.2 Purpose..... 1

2 Referenced Standards 1

3 Definitions 1

4 Performance Requirements 2

 4.1 General 2

 4.2 Mechanical Tests..... 2

 4.3 Electrical Tests 3

 4.4 Sealing Tests 5

 4.5 Reusability—Optional (Required for Connectors Designated as Reusable Only) 5

5 Sampling 5

 5.1 General 5

 5.2 Mechanical..... 6

 5.3 Electrical 6

 5.4 Sealing Tests 6

 5.5 Reusability 6

6 Test Methods 7

 6.1 General 7

 6.2 Mechanical Tests..... 7

 6.3 Electrical Tests 8

 6.4 Sealing Test..... 13

 6.5 Reusability 15

7 Test Report 15

8 Marking 16

 8.1 Connector System Marking 16

 8.2 Optional Test Markings..... 16

 8.3 Assembly Instructions..... 16

Annexes

A Standards that are Applicable to C119.1 27

B Heat Cycle Data Sheet..... 28

C Suggested Thermocouple Locations 29

D Guarded Circuit 31

E Integrity of Seal Data Sheet 33

F Impact Data Sheet 34

Tables

Table 1 Tensile Load, AWG Cable 17
Table 2 Tensile Load, Metric Cable 17
Table 3 Test Duration..... 18
Table 4 Resistance and Temperature Measurement Intervals..... 18
Table 5 Conductor Lengths for Current Cycle Tests, AWG Sizes 18
Table 6 Conductor Lengths for Current Cycle Tests, Metric Sizes..... 19
Table 7 Suggested Initial Test Current to Raise AWG Control Conductor Temperature 100°C 20
Table 8 Suggested Initial Test Current to Raise Metric Control Conductor Temperature 100°C..... 20
Table 9 Minimum Current Cycle Periods for AWG Control Conductors 21
Table 10 Minimum Current Cycle Periods for Metric Control Conductors 21

Figures

Figure 1 Impact 22
Figure 2 Heat Cycle Schematic 23
Figure 3 Heat Cycle Schematic (Vertical)..... 24
Figure 4 ISUL Schematic 25
Figure 5 Flexing and Twisting 26

Foreword (Neither this foreword nor any of the informative annexes is a part of American National Standard C119.1-2011.)

This standard covers electrical, mechanical, and sealing requirements of connectors rated 600 volts and installed underground.

This standard was initially developed by an EEI-NEMA Joint Committee on Underground Distribution Connectors and Connector Systems and published by the American National Standards Institute in 1974.

This revision has been reorganized to follow international formatting and improve the organization of information throughout the document when compared to the previous version.

Substantive changes to the standard have been made in the C119.1-2011 version of the standard. A substantive change is one that directly and materially affects performance of a product and which requires testing or retesting to meet the current edition of a standard. The substantive changes to the standard are:

This revision includes the addition of spreadsheet files in Annex B that can be used to collect current cycle test data, calculate connector stability, generate graphs of the data, and print the data to provide test results as part of the test report. The spreadsheets are provided to give test laboratories a standardized method to collect, calculate, and report test data and prepare test reports. These spreadsheets were not part of earlier editions.

This revision also includes the addition a spreadsheet file for Integrity of Seal Data in Annex E and a spreadsheet file for Impact Data in Annex F. The spreadsheets are provided to give a standardized format to collect, calculate, and report test data and test results. These spreadsheets were not part of earlier editions.

Other additions include Torque Strength Requirements for set screws, Impact Test (for Direct Burial Qualification), Resealability Test, Reusability Test, and Current Cycle Temperature Stability calculation.

Suggestions for improvement of this standard are welcome. They should be sent to:

Vice President, Technical Services
National Electrical Manufacturers Association
1300 North 17th Street, Suite 1752
Rosslyn, VA 22209

This standard was processed and approved for submittal to ANSI by the Accredited Standards Committee on Connectors for Electrical Utility Applications, C119. Committee approval of this standard does not necessarily imply that all committee members voted for its approval. At the time it approved this standard, the ANSI ASC C119 Committee had the following members:

Douglas Harms, Chairman
Ronald Lai, Vice Chairman
Paul Orr, Secretary

Organization Represented
Aluminum Association

Electric Utility Industry

Jean-Marie Asselin

Michael Dyer
Warren Hadley
Douglas Harms
James Harris
Harry Hayes
Alan Kasanow

National Electrical Manufacturers Association

J.C. Mathieson
Jesus Rodriguez
Curt Schultz
Gerald Wasielewski
David West
Michael Zaffina

Jason Bundren
Scott Casler
Barry Johnson
Ronald Lai
John Makal
Colin McCullough
Michael Miloshoff
Greg Nienaber
Wayne Quesnel
Carl Tamm
Carl Taylor
James Zahnen

Rural Utilities Service (RUS)

Trung Hiu

Tennessee Valley Authority

Jeffrey Nelson

Testing Laboratories

Jake Killinger
Chris Morton
Craig Pon
Paul Springer
Giovanni Velazquez

Other

Peter Bowers
Tip Goodwin
Stanley Hodgins
John Olenik
Joe Renowden
Allen Wilcox

The C119.1 Subcommittee on Sealed Underground Connector Systems, which developed the revisions of this standard, had the following members:

James Zahnen, Chairman

David West, Vice Chairman

Paul Orr, Secretary

Peter Bowers
Jason Bundren
Scott Casler
Michael Dyer
Warren C. Hadley
Douglas P. Harms
Harry Hayes
Trung Hiu
Barry Johnson
Alan Kasanow

Jake Killinger
Ronald Lai
John Makal
J.C. Mathieson
Colin McCullough
Richard Morin
Greg T. Nienaber
Jesus Rodriguez
Curt Schultz
Paul Springer
Carl R. Tamm
Carl Taylor
Giovanni Velazquez
Richard (Jeff) J. Waidelich
Gerald Wasielewski
David West
Allen Wilcox
Michael Zaffina
James Zahnen

< This page intentionally left blank. >

For Electric Connectors—**Sealed Insulated Underground Connector Systems Rated 600 Volts****1 Scope and Purpose****1.1 Scope**

This standard covers sealed insulated underground connector systems rated at six hundred (600) volts for utility applications and establishes electrical, mechanical, and sealing requirements for sealed insulated underground connector systems.

1.2 Purpose

The purpose of this standard is to give reasonable assurance to the user that sealed insulated underground connector systems meeting the requirements of this standard will perform in a satisfactory manner, provided they have been properly selected for the intended application and are installed in accordance with the manufacturer's recommendations.

2 Referenced Standards

This standard is intended to be used in conjunction with the following standards. When a referenced standard is superseded by a revision approved by the American National Standards Institute, the referenced revision shall apply. Standards that are referenced by inference are shown in Annex A.

ASTM E4-2010 *Standard Practices for Force Verification of Testing Machines*

IEEE 837-2002 *IEEE Standard for Qualifying Permanent Connections Used in Substation Grounding*

3 Definitions

CCST: Current Cycle Submersion Test, where current cycle heating is done in air and cooling is done using water submersion.

CCT: Current Cycle Test, where current cycle heating and cooling are done in air.

connector: A metallic device joining two or more conductors for the purpose of providing a continuous electrical path.

connector assembly: The connector system installed on the conductor(s).

connector system: A connector and its associated insulating and sealing components.

control cable: A conductor of the same type and size as the conductor in the current cycle loop that serves as a reference for setting test current and monitoring temperature.

guarded circuit: A circuit used to eliminate or to minimize the current flow between the insulation and conductor ends, caused by surface leakage currents.

input conductor: Conductor on the supply side of the connector.

output conductor: Conductor on the load side of the connector.