

Australian/New Zealand Standard™

**Demand response capabilities and  
supporting technologies for electrical  
products**

**Part 3.5: Interaction of demand  
response enabling devices and  
electrical products—Operational  
instructions and connections for grid-  
connected electrical energy storage  
(EES) systems**



## **AS/NZS 4755.3.5:2016**

This Joint Australian/New Zealand Standard was prepared by Joint Technical Committee EL-054, Remote Demand Management of Electrical Products. It was approved on behalf of the Council of Standards Australia on 18 May 2016 and by the New Zealand Standards Approval Board on 2 June 2016. This Standard was published on 21 June 2016.

---

The following are represented on Committee EL-054:

Airconditioning and Refrigeration Equipment Manufacturers Association of Australia  
Australian Industry Group  
Clean Energy Council  
Consumer Electronics Suppliers Association  
Consumers Federation of Australia  
CSIRO  
Department of Industry, Innovation and Science, Australia  
Electricity Engineers Association, New Zealand  
Energy Efficiency and Conservation Authority of New Zealand  
Energy Networks Association  
Heating, Ventilation and Air Conditioning New Zealand  
International Copper Association, Australia  
Smart Grid Australia  
Swimming Pool and Spa Association of Australia

---

### **Keeping Standards up-to-date**

Standards are living documents which reflect progress in science, technology and systems. To maintain their currency, all Standards are periodically reviewed, and new editions are published. Between editions, amendments may be issued. Standards may also be withdrawn. It is important that readers assure themselves they are using a current Standard, which should include any amendments which may have been published since the Standard was purchased.

Detailed information about joint Australian/New Zealand Standards can be found by visiting the Standards Web Shop at [www.saiglobal.com](http://www.saiglobal.com) or Standards New Zealand web site at [www.standards.govt.nz](http://www.standards.govt.nz) and looking up the relevant Standard in the on-line catalogue.

For more frequent listings or notification of revisions, amendments and withdrawals, Standards Australia and Standards New Zealand offer a number of update options. For information about these services, users should contact their respective national Standards organization.

We also welcome suggestions for improvement in our Standards, and especially encourage readers to notify us immediately of any apparent inaccuracies or ambiguities. Please address your comments to the Chief Executive of Standards Australia or the New Zealand Standards Executive at the address shown on the back cover.

---

Australian/New Zealand Standard™

**Demand response capabilities and  
supporting technologies for electrical  
products**

**Part 3.5: Interaction of demand  
response enabling devices and  
electrical products—Operational  
instructions and connections for grid-  
connected electrical energy storage  
(EES) systems**

First published as AS/NZS 4755.3.5:2016.

**COPYRIGHT**

© Standards Australia Limited/Standards New Zealand

All rights are reserved. No part of this work may be reproduced or copied in any form or by any means, electronic or mechanical, including photocopying, without the written permission of the publisher, unless otherwise permitted under the Copyright Act 1968 (Australia) or the Copyright Act 1994 (New Zealand).

Jointly published by SAI Global Limited under licence from Standards Australia Limited, GPO Box 476, Sydney, NSW 2001 and by Standards New Zealand, PO Box 10729, Wellington 6011.

ISBN 978 1 76035 509 8

## PREFACE

This Standard was prepared by the Joint Standards Australia/Standards New Zealand Committee EL-054, Remote Demand Management of Electrical Products.

This Standard forms part of the evolving AS/NZS 4755 series of Standards, which is intended to define the nomenclature, architecture and operational instructions for systems that can be used to remotely control electrical products. At the time of publication of this Part, the AS/NZS 4755 series is proposed to comprise the following:


### AS/NZS

- 4755 Demand response capabilities and supporting technologies for electrical products
- 4755.1 Part 1: Framework for demand response capabilities and requirements for demand response enabling devices (DREDS) (in preparation to supersede AS 4755—2007)
- 4755.3.1 Part 3.1: Interaction of demand response enabling devices and electrical products—Operational instructions and connections for air conditioners
- 4755.3.2 Part 3.2: Interaction of demand response enabling devices and electrical products—Operational instructions and connections for devices controlling swimming pool pump-units
- 4755.3.3 Part 3.3: Interaction of demand response enabling devices and electrical products—Operational instructions and connections for electric and electric-boosted water heaters
- 4755.3.4 Part 3.4: Interaction of demand response enabling devices and electrical products—Operational instructions and connections for grid-connected charge/discharge controllers for electric vehicles (EVSEs) (proposed new Standard)
- 4755.3.5 Part 3.5: Interaction of demand response enabling devices and electrical products—Operational instructions and connections for grid-connected electrical energy storage (EES) systems (this Standard)

The AS/NZS 4755 framework is also relevant to AS and AS/NZS 4777 series, *Grid connection of energy systems via inverters*.

Statements expressed in mandatory terms in notes and footnotes to tables are deemed to be requirements of this Standard.

The diagram below depicts the relationship of this Standard to other related Standards within the AS/NZS 4755 framework. This Standard covers the interaction of the demand response controllers of electrical energy storage systems with DREDS to control the flow of energy through the grid interactive port of the system.

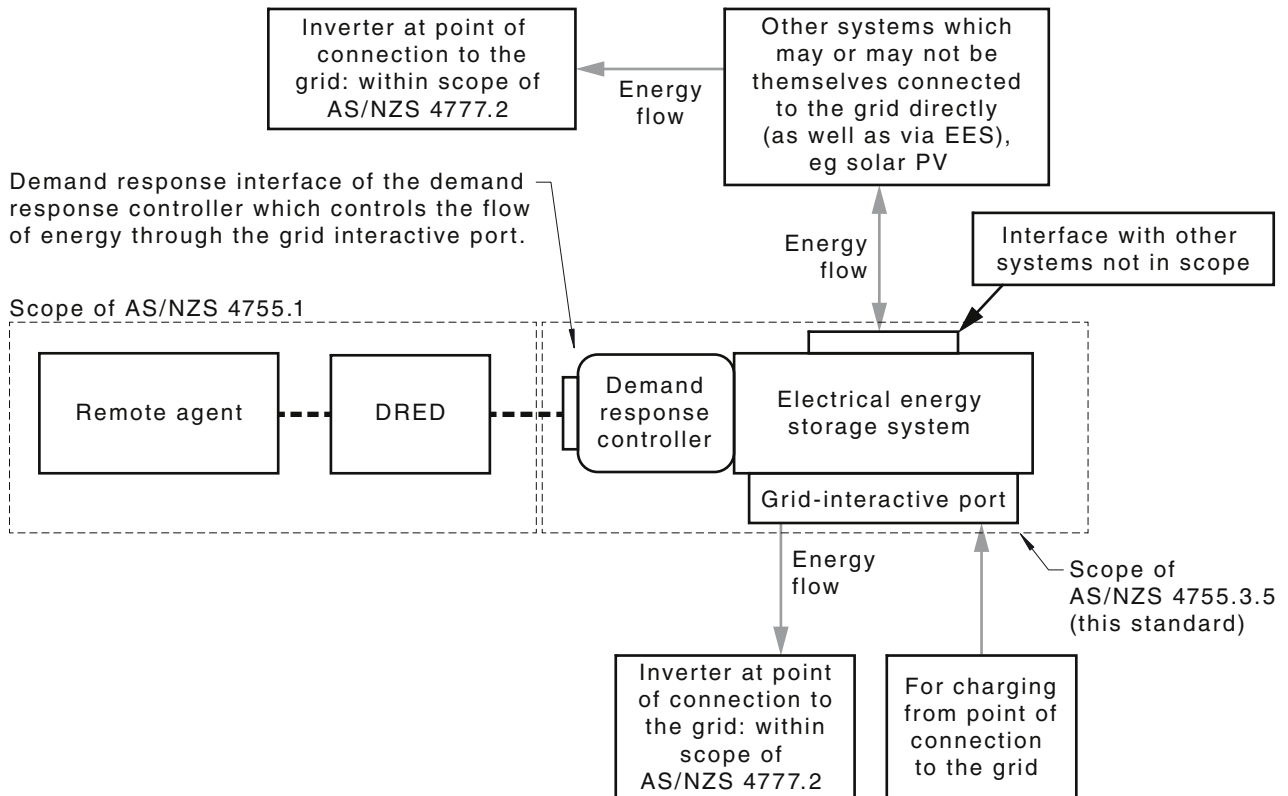

This Standard is intended to support demand response programs which optimize the operation of the electricity supply system and allow the efficient planning and use of capital equipment, while minimizing the risks to the comfort and amenity of users.

This Standard does not cover all aspects of construction and performance, which may be subject to other standards.

The term 'normative' and 'informative' have been used in this Standard to define the application of the appendix to which they apply. A 'normative' appendix is an integral part of a Standard, whereas an 'informative' appendix is only for information and guidance.

## CONTENTS

	<i>Page</i>
SECTION 1 SCOPE AND GENERAL	
1.1 SCOPE.....	5
1.2 REFERENCED DOCUMENTS.....	6
1.3 DEFINITIONS.....	6
SECTION 2 OPERATIONAL INSTRUCTIONS AND DEMAND RESPONSE MODES	
2.1 GENERAL PRINCIPLES.....	11
2.2 DEMAND RESPONSE MODES.....	11
2.3 POWER QUALITY SUPPORT.....	19
2.4 MANUAL OVER-RIDE.....	19
2.5 RESPONSE TIMES.....	19
2.6 RECONNECTION OF DISCONNECTION DEVICE.....	19
SECTION 3 INTERFACES	
3.1 GENERAL.....	20
3.2 PHYSICAL INTERFACES.....	20
3.3 TERMINAL BLOCK.....	20
3.4 RJ45 SOCKET.....	20
3.5 CIRCUIT TO DRED.....	22
3.6 OPTIONAL 230 V AC POWER SUPPLY.....	23
3.7 OPTIONAL EXTRA LOW VOLTAGE POWER SUPPLY.....	23
3.8 LOCATION AND ACCESS.....	23
SECTION 4 LABELLING AND MARKING OF DEMAND RESPONSE CAPABILITY	
4.1 GENERAL.....	24
4.2 REGISTRATION.....	24
4.3 POINT OF SALE LABELLING.....	24
4.4 MARKING.....	24
4.5 DOCUMENTATION.....	25
SECTION 5 TESTING AND VERIFYING DEMAND RESPONSE CAPABILITY	
5.1 GENERAL.....	26
5.2 GENERAL TEST PROVISIONS.....	26
5.3 SET-UP FOR TESTING (ALL TESTS).....	26
5.4 VERIFICATION OF CLAIMED DEMAND RESPONSE CAPABILITIES.....	27
5.5 COMPLIANCE CRITERIA.....	27
5.6 VERIFICATION OF CLAIMED COMPLIANCE.....	28
5.7 TEST REPORT.....	30
APPENDICES	
A REQUIRED RESPONSES TO COMBINATIONS OF OPERATIONAL INSTRUCTIONS.....	31
B REGISTRATION INFORMATION FOR EES SYSTEM DEMAND RESPONSE CONTROLLERS.....	50
C REPORT ON VERIFICATION OF COMPLIANCE WITH AS/NZS 4755.3.5.....	52
D EXAMPLE OF CIRCUIT WITH 6 PIN CONNECTIONS.....	54
E EXAMPLES OF EES SYSTEMS.....	55
F DRED INTERFACE.....	69

STANDARDS AUSTRALIA/STANDARDS NEW ZEALAND

**Australian/New Zealand Standard**

**Demand response capabilities and supporting technologies for electrical products**

Part 3.5: Interaction of demand response enabling devices and electrical products—Operational instructions and connections for grid-connected electrical energy storage (EES) systems

S E C T I O N 1 S C O P E A N D G E N E R A L

**1.1 SCOPE**

This Standard—

- (a) applies to electrical energy storage (EES) systems that—
  - (i) do not contain a demand response enabling device (DRED);
  - (ii) have a demand response interface intended to connect to a DRED;
  - (iii) have a low voltage, permanently wired connection to the grid (whether single-phase or three-phase); and
  - (iv) are capable of importing energy from the grid, exporting energy to the grid, or both.
- (b) specifies a set of operational instructions to control the demand response of EES systems;
- (c) specifies methods of connecting the demand response interface to the DRED; and
- (d) provides methods of testing to verify compliance.

EES systems covered by this Standard include, but are not restricted to—

- (i) electrochemical storage systems (e.g. batteries);
- (ii) mechanical storage systems (e.g. flywheel);
- (iii) electrical storage systems (e.g. capacitors);
- (iv) uninterruptible power supplies (UPS);
- (v) thermal and chemical systems; and
- (vi) generation systems that are dispatchable.

An EES system may also meet the definition of an inverter energy system as defined in AS/NZS 4777.2.

NOTE: Examples of EES system configurations are given in Appendix E.

An EES system complying with this Standard may also have additional interfaces and other means of achieving demand response.

This Standard does not cover any other electrical product within the scope of AS/NZS 4755.3 series Standards.