


Australian Standard 1646—1984

1987

RUBBER JOINT RINGS FOR WATER SUPPLY, SEWERAGE AND DRAINAGE PURPOSES

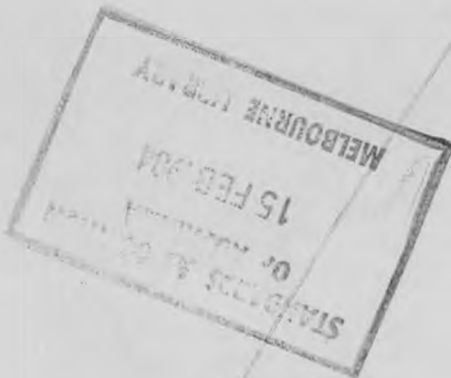

STANDARDS ASSOCIATION OF AUSTRALIA
Incorporated by Royal Charter

This Australian standard was prepared by Committee WS/10, Flexible Jointing Gaskets. It was approved on behalf of the Council of the Standards Association of Australia on 18 August 1983 and published on 6 February 1984.

The following interests are represented on Committee WS/10:

Confederation of Australian Industry
Department of Public Works, N.S.W.
Engineering and Water Supply Department, S.A.
Gas and Fuel Corporation of Victoria
Hunter District Water Board
Institution of Engineers Australia
Melbourne and Metropolitan Board of Works
Metropolitan Water Sewerage and Drainage Board
Plastics Institute of Australia Incorporated
Queensland Joint Committee
State Rivers and Water Supply Commission Victoria

Review of Australian Standards. To keep abreast of progress in industry, Australian standards are subject to periodic review and are kept up-to-date by the issue of amendments or new editions as necessary. It is important therefore that standards users ensure that they are in possession of the latest edition, and any amendments thereto.

Full details of all SAA publications will be found in the Annual List of Australian Standards; this information is supplemented each month by SAA's journal 'The Australian Standard', which subscribing members receive, and which gives details of new publications, new editions and amendments, and of withdrawn standards.

Suggestions for improvements to Australian standards, addressed to the head office of the Association, are welcomed. Notification of any inaccuracy or ambiguity found in an Australian standard should be made without delay in order that the matter may be investigated and appropriate action taken.

This standard was issued in draft form for comment as DR 81123 and DR 81124-7.

AUSTRALIAN STANDARD

RUBBER JOINT RINGS FOR WATER SUPPLY, SEWERAGE AND DRAINAGE PURPOSES

AS 1646—1984

First issued (as AS A139)	
BS 2924: Part 1: 1955 endorsed	1964
Revised	1972
Revised and issued as AS 1646	1974
Reprinted	1974
Reprinted	1981
Revised	1984

PUBLISHED BY THE STANDARDS ASSOCIATION OF AUSTRALIA
STANDARDS HOUSE, 80 ARTHUR ST, NORTH SYDNEY, N.S.W.

ISBN 0 7262 3197 5

PREFACE

This edition of this standard was prepared by the Association's Committee on Flexible Jointing Gaskets to supersede AS 1646—1974. The standard applies to rings made from vulcanized natural rubber and a selected range of synthetic rubbers intended for the jointing of pipes for water supply, sewerage and drainage purposes.

The standard sets out compositions and physical properties for these materials, compliance with which is known to give satisfactory service in water supply, sewerage and drainage services.

It should be recognized however, that, when rings are intended for use where the likelihood of microorganism attack is high special precautions may need to be taken. This standard covers rubber rings incorporating root growth inhibitor and these are intended only for sewerage and drainage purposes.

RINGS CONTAINING ROOT GROWTH INHIBITOR SHALL NOT BE USED IN WATER SUPPLY SYSTEMS.

The root growth inhibitor selected should aim to protect rubber ring joints against the action of the roots of all plant species, to have no adverse effect upon persons handling such rings, and to avoid adverse effects on any sewage treatment process or the life of the ring itself under service conditions.

These criteria should be applied in a practical way taking account of existing test results and other information available on the characteristics of the inhibitor.

This edition of the standard incorporates two additional appendices. One is to give manufacturers an indication of the quality control testing required by statutory authorities, while the other sets out a procedure for forwarding samples of used rubber rings for assessment in the laboratory.

©Copyright — STANDARDS ASSOCIATION OF AUSTRALIA 1984

Users of standards are reminded that copyright subsists in all SAA publications. No part of this publication may be reproduced, stored in a retrieval system in any form or transmitted by any means without prior permission in writing of the Standards Association of Australia.

CONTENTS

	<i>Page</i>
SECTION 1. SCOPE AND GENERAL	
1.1 Scope	4
1.2 Referenced Documents	4
1.3 Definitions	4
1.4 Tolerances on Dimensions	4
SECTION 2. MATERIALS AND COMPOSITION	
2.1 Material....	5
2.2 Composition of Rings	5
SECTION 3. PROPERTIES OF RUBBER MATERIALS	
3.1 General	7
3.2 Hardness	7
3.3 Tensile Strength and Elongation at Break	7
3.4 Compression Set	7
3.5 Accelerated Ageing	7
3.6 Water Absorption	7
3.7 Liquid Immersion	7
3.8 Ozone Resistance	7
3.9 Compression Stress Relaxation	7
SECTION 4. PROPERTIES OF RUBBER RINGS	
4.1 Construction and Workmanship	9
4.2 Ring Hardness	9
4.3 Low Temperature Hardness Test	9
4.4 Joins	9
SECTION 5. MARKING AND PACKAGING	
5.1 Marking....	10
5.2 Packaging and Labelling	10
5.3 Storage and Handling of Rings	10
APPENDICES	
A Purchasing Guidelines	11
B Determination of Ring Hardness	12
C Root Growth Inhibitor	18
D Determination of Compressive Strength Relaxation—Referee Method	19
E Determination of Compressive Strength Relaxation—Alternative Method	22
F Testing of Joins in Rings	24
G Information on Quality Control Requirements....	25
H Handling, Packing and Transporting Rubber Ring Samples for Assessment after Service Use	26

STANDARDS ASSOCIATION OF AUSTRALIA

Australian Standard

for

RUBBER JOINT RINGS FOR WATER SUPPLY, SEWERAGE AND DRAINAGE PURPOSES

SECTION 1. SCOPE AND GENERAL

1.1 SCOPE. This standard specifies requirements for vulcanized natural rubber rings and a selected range of vulcanized synthetic rings intended primarily for use in the jointing of pipes for water supply, sewerage and drainage. The standard also specifies requirements for such rings which incorporate root growth inhibitor and which are intended for sewerage and drainage purposes only. Dimensions are not specified. Methods for testing rubber joint rings are detailed in Appendices.

NOTES:

1. RUBBER RINGS INCORPORATING ROOT GROWTH INHIBITOR SHALL NOT BE USED IN WATER SUPPLY SYSTEMS.
2. Guidelines to purchasers on requirements that must be specified by the purchaser and by the manufacturer, and those that must or may be agreed upon at the time of the enquiry or order, are given in Appendix A.
3. The shape, cross-sectional dimensions plus internal and external diameters of the rings should be as specified in any Australian standard covering the pipe joint with which the rings are intended to be used, or as specified by the purchaser.

1.2 REFERENCED DOCUMENTS. The following standards are referred to in this standard:

AS 1199	Sampling Procedures and Tables for Inspection by Attributes
AS 1683	Methods of Test for Rubber
AS 1863	Coated Abrasives (technical products)
AS CK15	Code of Recommended Practice for the Storage of Vulcanized Elastomers
BS 903	Methods of Testing Vulcanized Rubber
	Part A16 The Resistance of Vulcanized Rubber to Liquids

Part A19 Heat Resistance and Accelerated Ageing Tests
Part A26 Determination of Hardness

BS 2719	Methods of Use and Calibration of Pocket Type Rubber Hardness Meters
BS 4396	Raw Natural Rubber
ASTM D297	Rubber Products—Chemical Analysis
ASTM D1149	Test Method for Rubber Deterioration—Surface Ozone Cracking in a Chamber (Flat Specimen)

1.3 DEFINITIONS. For the purpose of this standard, the following definitions apply:

1.3.1 Hardness of rubber material—the hardness of a rubber material other than rubber rings as measured on standard test pieces by the standard IRHD test in accordance with BS 903, Part A26.

1.3.2 Hardness of rubber rings—the hardness of rubber rings as determined by Appendix B of this standard.

1.3.3 Compressive stress relaxation—the reduction with time of the stress induced at constant deformation, expressed as the percentage reduction in the counterforce exerted at 1 minute clamped age.

1.4 TOLERANCES ON DIMENSIONS. Unless otherwise specified in the purchase order, the tolerances on the specified dimensions shall be as follows:

- (a) Cross-sectional dimensions +3, -2 percent.
- (b) Circumference of ring ± 2 percent but not exceeding 50 mm.